


3D VIEW
NOT TO SCALE

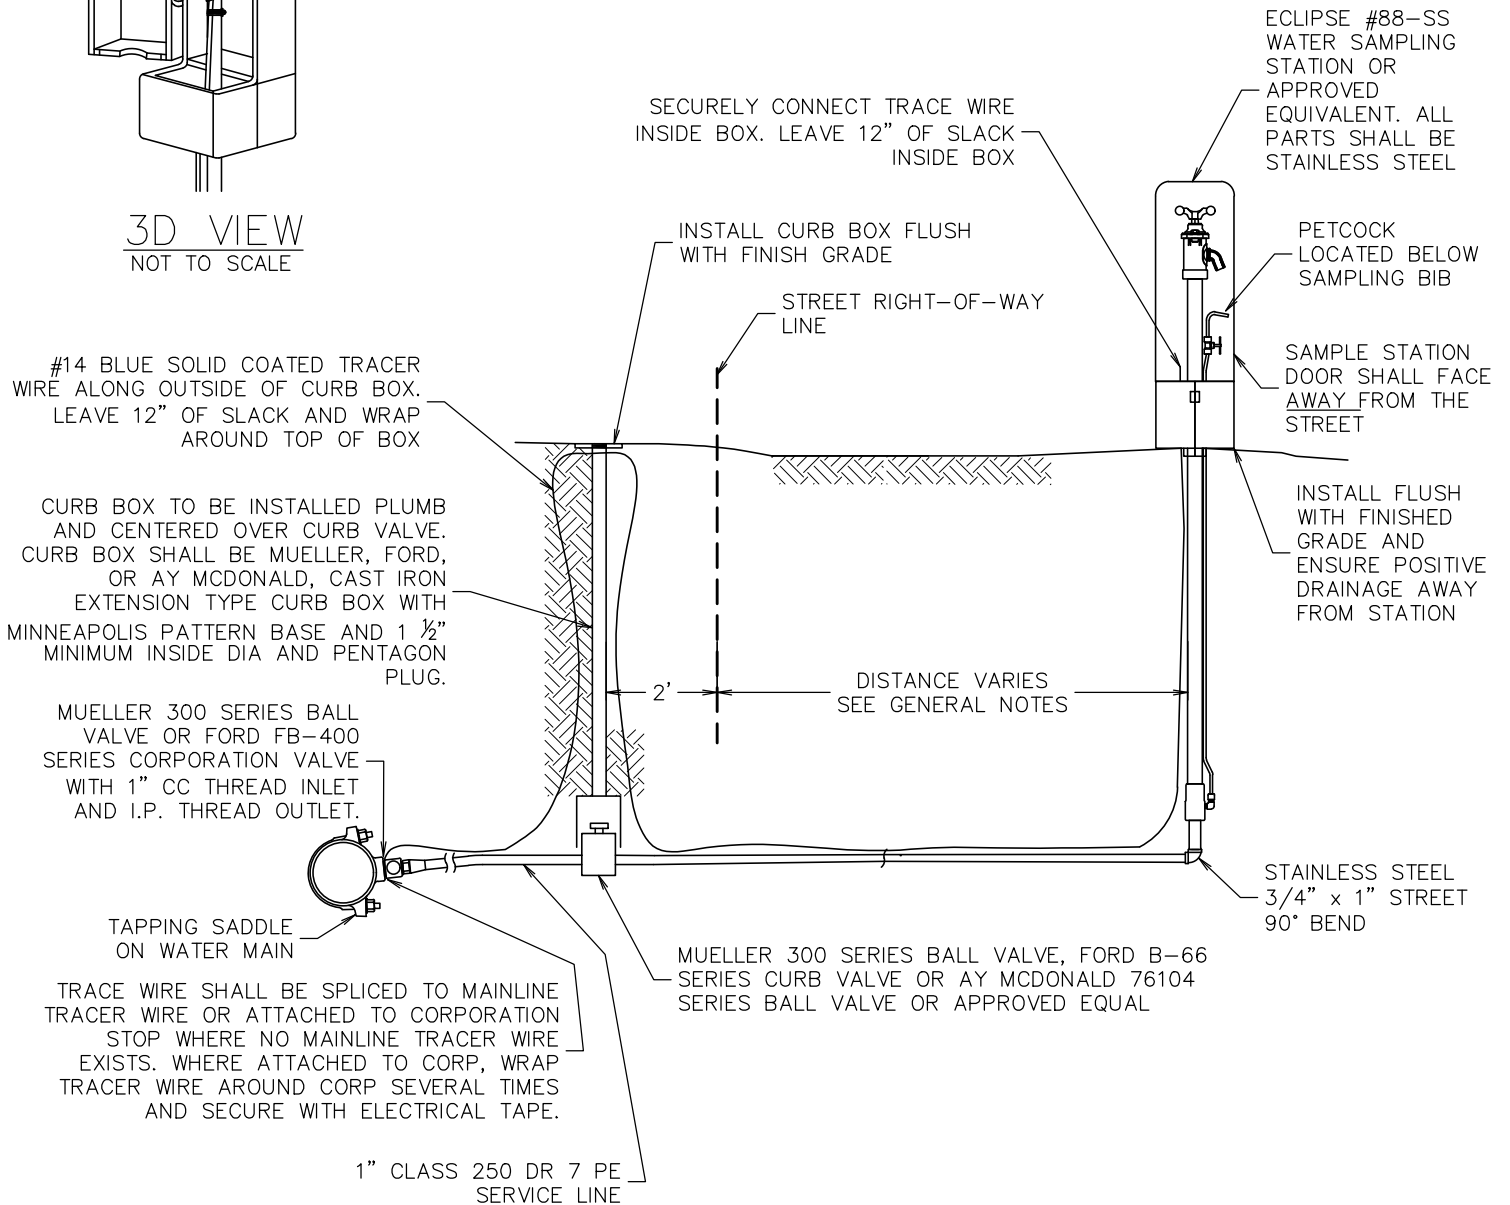

GENERAL NOTES:

1. SAMPLE STATION SHALL BE KUPFERLE ECLIPSE MODEL #88-SS OR APPROVED EQUIVALENT.
2. SAMPLE STATION SHALL BE A 6' BURY DEPTH.
3. SAMPLING STATION SHALL BE INSTALLED WHERE SHOWN ON THE DRAWINGS OR AS SPECIFIED BY CITY ENGINEERING
4. INSTALL A MAXIMUM OF 2' FROM SIDEWALKS AND MINIMUM OF 3' FROM BACK OF CURB. ENSURE MINIMUM OF 10' CLEARZONE.
5. DO NOT INSTALL UNDER DRIPLINE OF TREE
6. LOCK SHALL BE PROVIDED BY MISSOULA WATER.

December 2021



Engineering Division

Typical Water Sample Station Detail

Logan McInnis

Approved By
Utilities Engineer
Logan McInnis, PE

Revised:

STD - 414